




DSRSQ Therm

Variable geometry diffuser on 597x597 mm panel developed for rooms with high ceilings where a long throw and a high induction ratio are required. Made up of a half-housing in which simultaneously adjustable deflectors are equipped with a thermostatic system in order to change the air flow direction according to the required thermal conditions.

TECHNICAL SPECIFICATION AND USAGE LIMIT

INSTALLATION HEIGHT	APPLICATIONS	MAIN BELL MATERIAL	BLADES MATERIAL	SURFACE FINISH	COLOR	FASTENING
up to 16 m	Room cooling and heating	Aluminum	Galvanized Steel	Epoxy powder coating resistant to impact and abrasion	Standard RAL 9010 - glossy RAL 9016 - glossy RAL 9003 - mat	by means of screws positioned on the diffuser neck

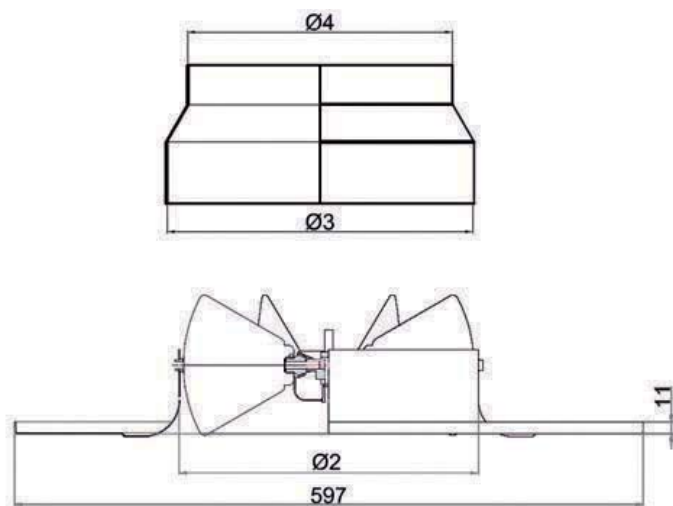

Nota:

The upper bell for fixing the DSRSQ Therm models is equipped with an equalizing grid.

GREEN BUILDING

Thanks also to the support of GreenMap, products manufactured by Tecnica srl contribute to obtain the credits of the major international rating systems for sustainable buildings:



LEED

Contributes to credits:
IP, EA, MR, EQ



WELL

Contributes to credits:
THERMAL COMFORT,
MATERIALS, COMMUNITY



BREEAM










Contributes to credits:
MAN, HEA, WST

For further details about specific contributions to the credits indicated, contact Tecnica Srl

TECHNICAL DATA

Model	Ø 2 [mm]	Ø 3 [mm]	Ø 4 [mm]
DSRQ 250	284	286	248
DSRQ 315	349	352	313
DSRQ 400	433	436	398

APPLICATIONS

								
Residential	Easy Pack	Calculation Method	REACH Certificat	RoHS Certificat	Industry	Building	Air Conditioning	Interior design

Heating function - 45° blades - Selection charts

DISTANCE BETWEEN CENTERS = (Flow Rate / 12 / Room Height)^{1/2}

*on request

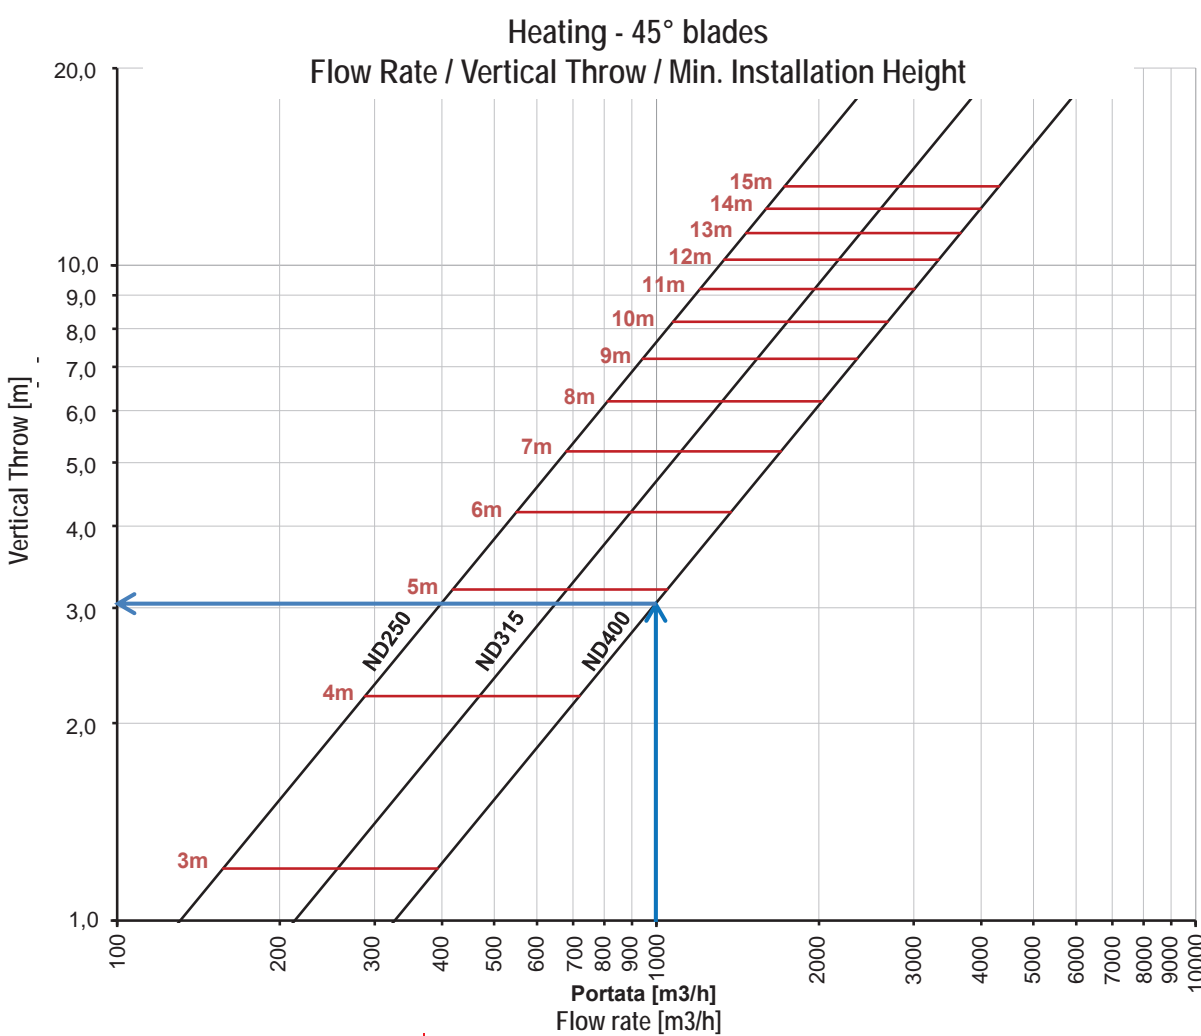
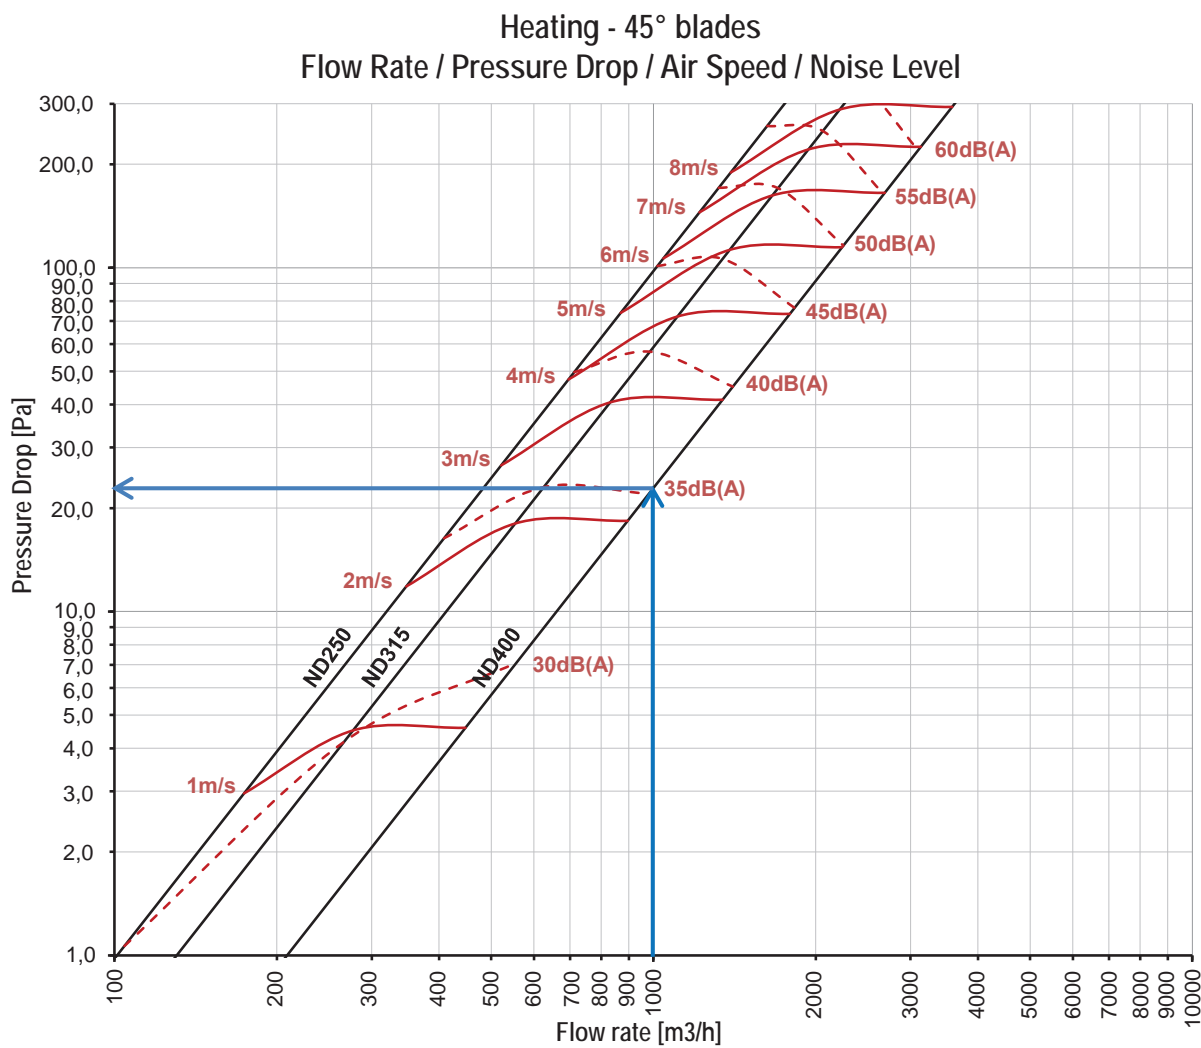


Diagram 1 Heating - 45° blades

The diagram shows the pressure drop of the diffuser based on the flow rate with relative indication of the noise level without environmental attenuation and speed of the incoming air flow. These data refer to the diffuser with blades at 45° for heating function.

CALCULATION (input data)

Total Flow Rate	10.000 m ³ /h
Max. Noise Level	35dB(A)
Number of diffusers expected	10pz.
Throw	3,00m

SELECTION

Model	DSRQ 400
Flow Rate	1.000 m ³ /h
Pressure Drop	+/- 25Pa
Noise Level	+/- 35dB(A)
Vertical Isothermal Throw	+/- 3,0m
Air Inlet Speed	+/- 2,2m/s
Min. Installation Height	+/- 4,9m

Diagram 2 Heating - 45° blades

The diagram shows the vertical isothermal throw of the diffuser based on the flow rate with terminal speed (Vt) of 0,25m/s, in addition to the indication of the minimum recommended installation height. These data refer to the diffuser with blades at 45° for heating function.

Note:

all operating data refer to diffusers with equalizing grid.

Cooling function - 67,5° blades - Selection charts

DISTANCE BETWEEN CENTERS = (Flow Rate / 12 / Room Height)^{1/2}

Diagram 3 Cooling – 67,5° blades

The diagram shows the pressure drop of the diffuser based on the flow rate with relative indication of the noise level without environmental attenuation and speed of the incoming air flow. These data refer to the diffuser with blades at 67,5° for cooling function.

CALCULATION (input data)	
Total Flow Rate	10.000 m ³ /h
Max. Noise Level	37dB(A)
Number of diffusers expected	10pz.
Throw	0,75m


SELECTION	
Model	DSRQ 400
Flow Rate	1.000 m ³ /h
Pressure Drop	+/- 40Pa
Noise Level	37dB(A)
Vertical Isothermal Throw	+/- 0,75m
Air Inlet Speed	+/- 2,2m/s
Min. Installation Height	+/- 2,7m

Diagram 4 Cooling – 67,5° blades


The diagram shows the vertical isothermal throw of the diffuser based on the flow rate with terminal speed (Vt) of 0,25m/s, in addition to the indication of the minimum recommended installation height. These data refer to the diffuser with blades at 67,5° for cooling function.

Note:
all operating data refer to diffusers with equalizing grid.

Cooling - 67,5° blades
Flow Rate / Pressure Drop / Air Speed / Noise Level

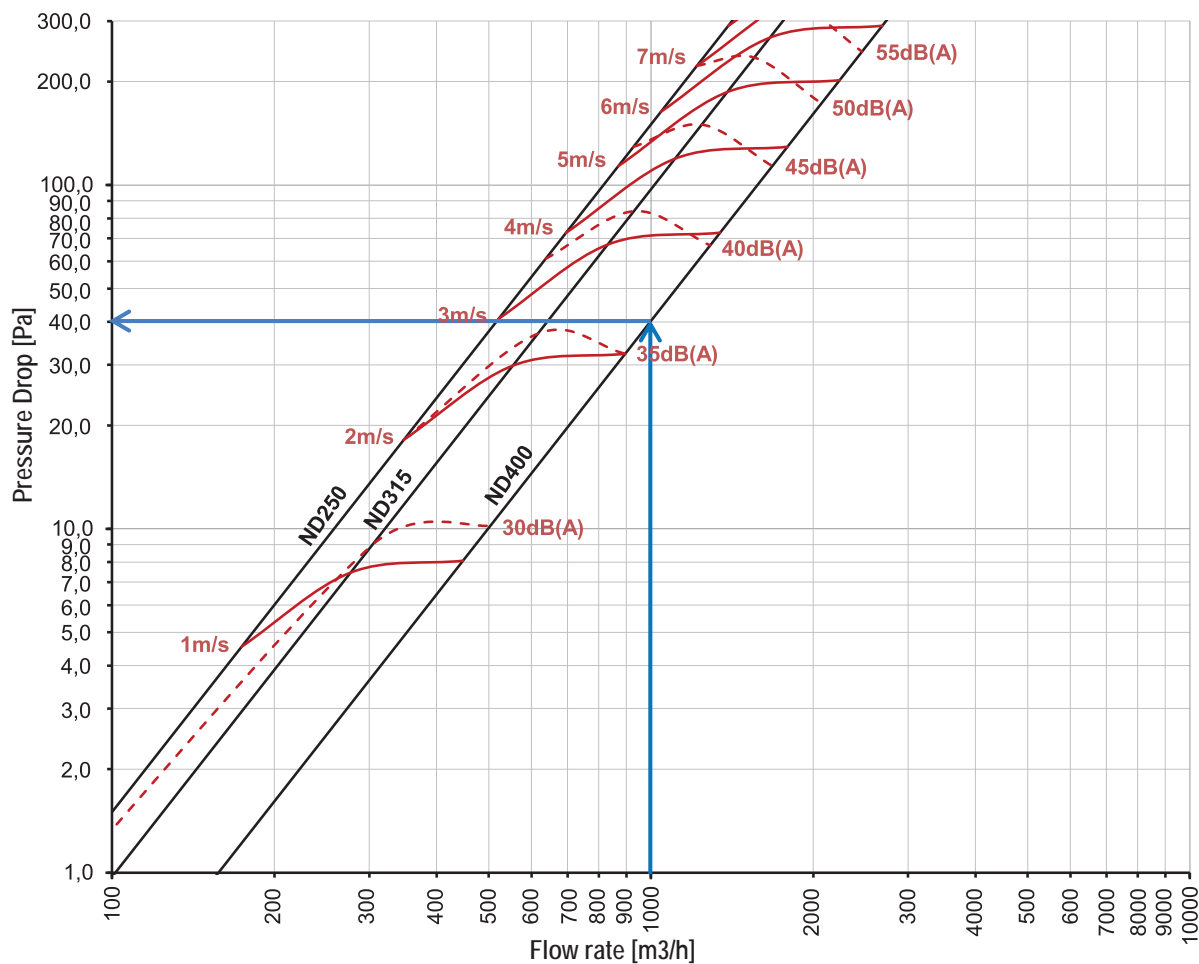

Cooling - 67,5° blades
Flow Rate / Vertical Throw / Min. Installation Height

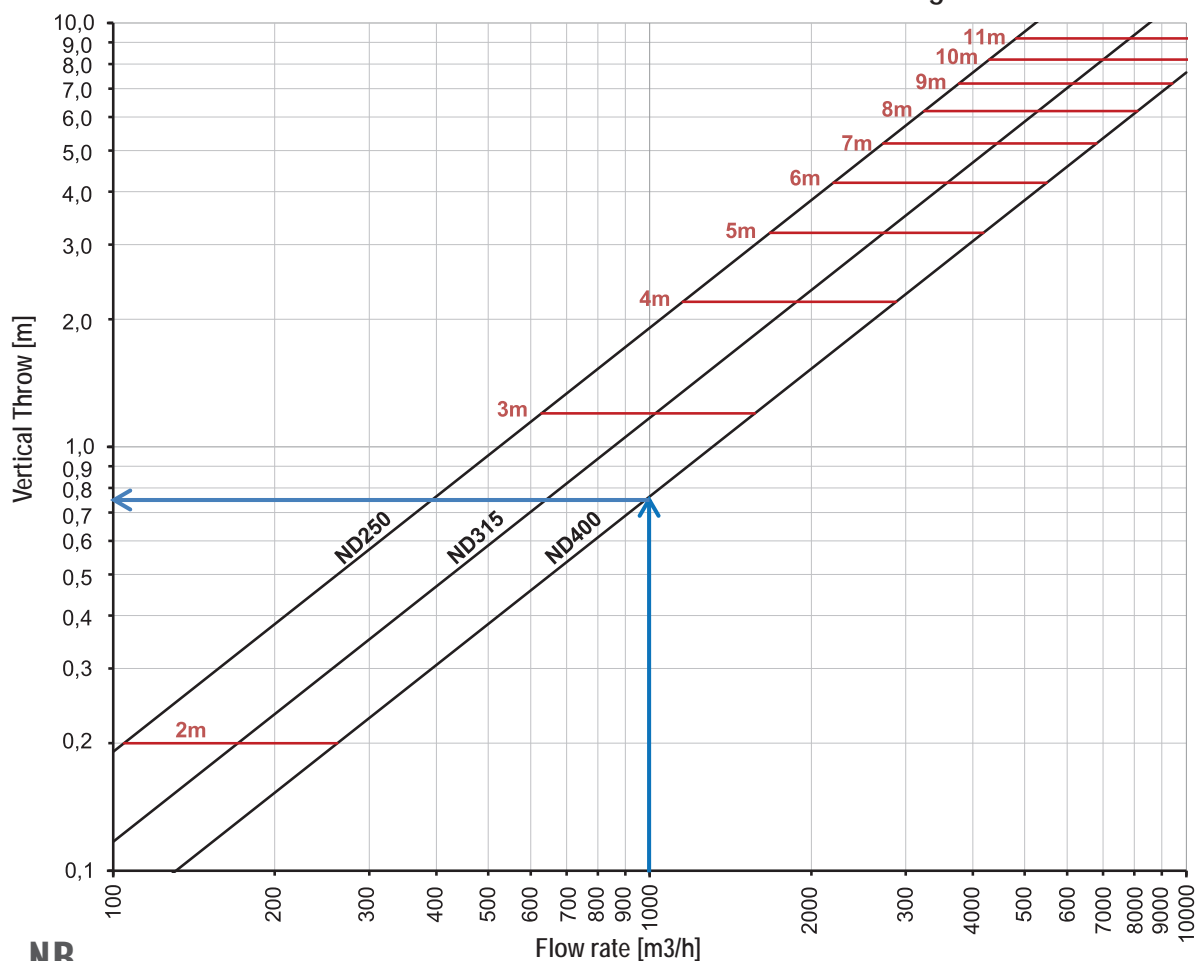

NB

- Pressure drop data shown in the diagram refer to the diffuser with the damper fully open.
- The data relating to the minimum installation height must be understood from the floor level. The air speed at the limit of the comfort zone (1,80m from the floor) is assumed equal to 0,25m/s.

HEATING - TABLE OF OPERATING DATA - 45° BLADES

MODEL	DESCRIPTION	U.M.	Vi (m/sec)									
			1	2	3	4	5	6	7	8	9	10
250 Ak: 0,04831m ²	Flow Rate	m ³ /h	174	348	522	696	869	1043	1217	1391	1565	1739
	Pressure Drop 45° Blades - Heating	Pa	3,0	11,8	26,6	47,3	73,9	106,5	144,9	189,3	239,6	295,8
	Vertical Throw Vt 0,25 45° Blades - Heating	mt	1,3	2,7	4,0	5,3	6,6	8,0	9,3	10,6	12,0	13,3
	Noise Level 45° Blades - Heating	dB(A)	32	34	37	40	43	46	49	52	54	57
	Min. Installation Height	mt	3,1	4,5	5,8	7,1	8,4	9,8	11,1	12,4	13,8	15,1
315 Ak: 0,07694m ²	Flow Rate	m ³ /h	277	554	831	1108	1385	1662	1939	2216	2493	2770
	Pressure Drop 45° Blades - Heating	Pa	4,5	18,0	40,6	72,1	112,7	162,3	220,9	288,6	365,2	450,9
	Vertical Throw Vt 0,25 45° Blades - Heating	mt	1,3	2,6	3,9	5,2	6,5	7,8	9,1	10,4	11,7	13,0
	Noise Level 45° Blades - Heating	dB(A)	30	34	38	42	46	49	53	57	61	65
	Min. Installation Height	mt	3,1	4,4	5,7	7,0	8,3	9,6	10,9	12,2	13,5	14,8
400 Ak: 0,12441m ²	Flow Rate	m ³ /h	448	896	1344	1792	2239	2687	3135	3583	4031	4479
	Pressure Drop 45° Blades - Heating	Pa	4,6	18,4	41,3	73,4	114,8	165,2	224,9	293,8	371,8	459,0
	Vertical Throw Vt 0,25 45° Blades - Heating	mt	1,4	2,7	4,1	5,5	6,8	8,2	9,6	11,0	12,3	13,7
	Noise Level 45° Blades - Heating	dB(A)	29	34	39	45	50	55	60	66	71	76
	Min. Installation Height	mt	3,2	4,5	5,9	7,3	8,6	10,0	11,4	12,8	14,1	15,5

i Note: the data indicated refer to operation in isothermal conditions

COOLING - TABLE OF OPERATING DATA - 67,5° BLADES

MODEL	DESCRIPTION	U.M.	Vi (m/sec)									
			1	2	3	4	5	6	7	8	9	10
250 Ak: 0,04831m ²	Flow Rate	m ³ /h	174	348	522	696	869	1043	1217	1391	1565	1739
	Pressure Drop 67,5° Blades - Heating	Pa	4,5	18,2	40,9	72,6	113,5	163,4	222,5	290,6	367,7	454,0
	Vertical Throw Vt 0,25 67,5° Blades - Heating	mt	0,3	0,7	1,0	1,3	1,7	2,0	2,3	2,7	3,0	3,3
	Noise Level 67,5° Blades - Heating	dB(A)	32	35	38	41	44	47	50	53	56	59
	Min. Installation Height	mt	3,1	4,5	5,8	7,1	8,4	9,8	11,1	12,4	13,8	15,1
315 Ak: 0,07694m ²	Flow Rate	m ³ /h	277	554	831	1108	1385	1662	1939	2216	2493	2770
	Pressure Drop 67,5° Blades - Heating	Pa	7,5	29,8	67,1	119,3	186,4	268,5	365,4	477,3	604,1	745,7
	Vertical Throw Vt 0,25 67,5° Blades - Heating	mt	0,3	0,6	1,0	1,3	1,6	1,9	2,3	2,6	2,9	3,2
	Noise Level 67,5° Blades - Heating	dB(A)	30	34	38	43	47	52	56	61	65	69
	Min. Installation Height	mt	3,1	4,4	5,7	7,0	8,3	9,6	10,9	12,2	13,5	14,8
400 Ak: 0,12441m ²	Flow Rate	m ³ /h	448	896	1344	1792	2239	2687	3135	3583	4031	4479
	Pressure Drop 67,5° Blades - Heating	Pa	8,1	32,3	72,7	129,2	201,9	290,8	395,8	516,9	654,2	807,7
	Vertical Throw Vt 0,25 67,5° Blades - Heating	mt	0,3	0,7	1,0	1,4	1,7	2,1	2,4	2,7	3,1	3,4
	Noise Level 67,5° Blades - Heating	dB(A)	29	35	41	46	52	58	64	69	75	81
	Min. Installation Height	mt	3,2	4,5	5,9	7,3	8,6	10,0	11,4	12,8	14,1	15,5